

TYPICAL CONCRETE DRAINAGE PIPE TRENCH DETAIL

(36"-72" RCP) AND [42"-96" RCPA]

N.T.S.

(RCP) & [RCPA] MINIMUM \*\*\* BEDDING THICKNESS (in.)

UNDISTURBED SUBGRADE NET ALLOWABLE SOIL BEARING CAPACITY (psf.)					
PIPE SIZE (RCP) (RCPA)	BEDDING LAYER	300-400	401-500	501-600	601-700 >700
(36" & 42")	(1)	20"	18"	16"	14" 12"
[42" & 48"]	(2)	8"	8"	8"	8" 8"
TOTAL THICKNESS		28"	26"	24"	22" 20"
(48" & 54")	(1)	22"	20"	18"	14" 12"
[54" & 60"]	(2)	10"	10"	10"	10" 10"
TOTAL THICKNESS		32"	30"	28"	24" 22"
(60" & 72")	(1)	34"	30"	26"	16" 14"
[72", 84" & 96"]	(2)	10"	10"	10"	10" 10"
TOTAL THICKNESS		44"	40"	36"	26" 24"

NOTES:  
 1. SIDE BEDDING WIDTH MAY BE REDUCED WITH ST BERNARD'S PARISH PROJECT ENGINEER'S APPROVAL.  
 2. THE DEPARTMENT OF ENGINEERING RESERVES THE RIGHT TO MODIFY PIPE BEDDING REQUIREMENTS IN ACCORDANCE WITH EXISTING FIELD CONDITIONS ENCOUNTERED DURING CONSTRUCTION.

3. TRENCH SAFETY IS THE RESPONSIBILITY OF THE CONTRACTOR. THE PARISH OR ITS REPRESENTATIVES RESERVE THE RIGHT TO REQUIRE THE CONTRACTOR TO MODIFY ANY PORTIONS OF SHORING SYSTEM DEEMED UNSAFE, BUT THE FINAL RESPONSIBILITY FOR THE WORKER'S SAFETY REMAINS WITH THE CONTRACTOR. TRENCH DESIGN AND CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE LATEST OSHA STANDARDS AND REQUIREMENTS.  
 4. TIMBER SHEETING, IF USED, MUST REMAIN IN PLACE AND BE CUT OFF A MINIMUM OF 3 FEET BELOW FINISHED GRADE.

5. ALL CONCRETE PIPE SHALL BE A.S.T.M. C-76 (RCP) AND A.S.T.M. C-506 [RCPA], CLASS III, WALL B, REINFORCED CONCRETE PIPE WITH TYPE 2 JOINTS.


6. THE CONTRACTOR MUST REVIEW ALL DETAILS AND CHARTS INCLUDED ON THIS STANDARD DRAWING SHEET PRIOR TO BIDDING. FOR PIPES 36" AND LARGER, THE TRENCH DESIGN AND BEDDING

THICKNESSES WILL VARY DEPENDING ON THE "UNDISTURBED SUBGRADE NET ALLOWABLE SOIL BEARING CAPACITY" VALUE. THE "DESCRIPTION SECTION" OF "TECHNICAL SPECIFICATIONS" FOR "CULVERTS AND STORM DRAINS" MUST REFERENCE THIS ST BERNARD STANDARD DRAWING AND MUST PROVIDE THE "UNDISTURBED SUBGRADE NET ALLOWABLE SOIL BEARING CAPACITY" VALUE.

7. WHERE GROUND WATER OR AN UNSTABLE TRENCH BOTTOM EXISTS, THE TRENCH BOTTOM SHALL BE STABILIZED (ASTM D2321) TO PROVIDE A WORKING PLATFORM. REMOVE MUCK OR OTHER SOFT MATERIAL, TREE ROOTS, AND/OR ANY OTHER UNDESIRABLE MATERIAL FROM THE TRENCH BOTTOM TO A DEPTH NECESSARY TO ESTABLISH A FIRM FOUNDATION.

8. GEOTECHNICAL REPORT'S RECOMMENDATIONS FOR PIPE BEDDING, IF MORE STRINGENT, SHALL SUPERSEDE THESE MINIMUM THICKNESSES.

PIPE DIA.	DIMENSION 'A'	DIMENSION 'B'
MIN.	MIN.	MIN.
15	6"	12"
18	6"	12"
21	6"	12"
24	6"	12"
30	12"	12"
36	12"	12"
42	12"	18"
48	12"	18"
54	15"	18"
60	18"	24"
66	18"	24"
72	18"	24"

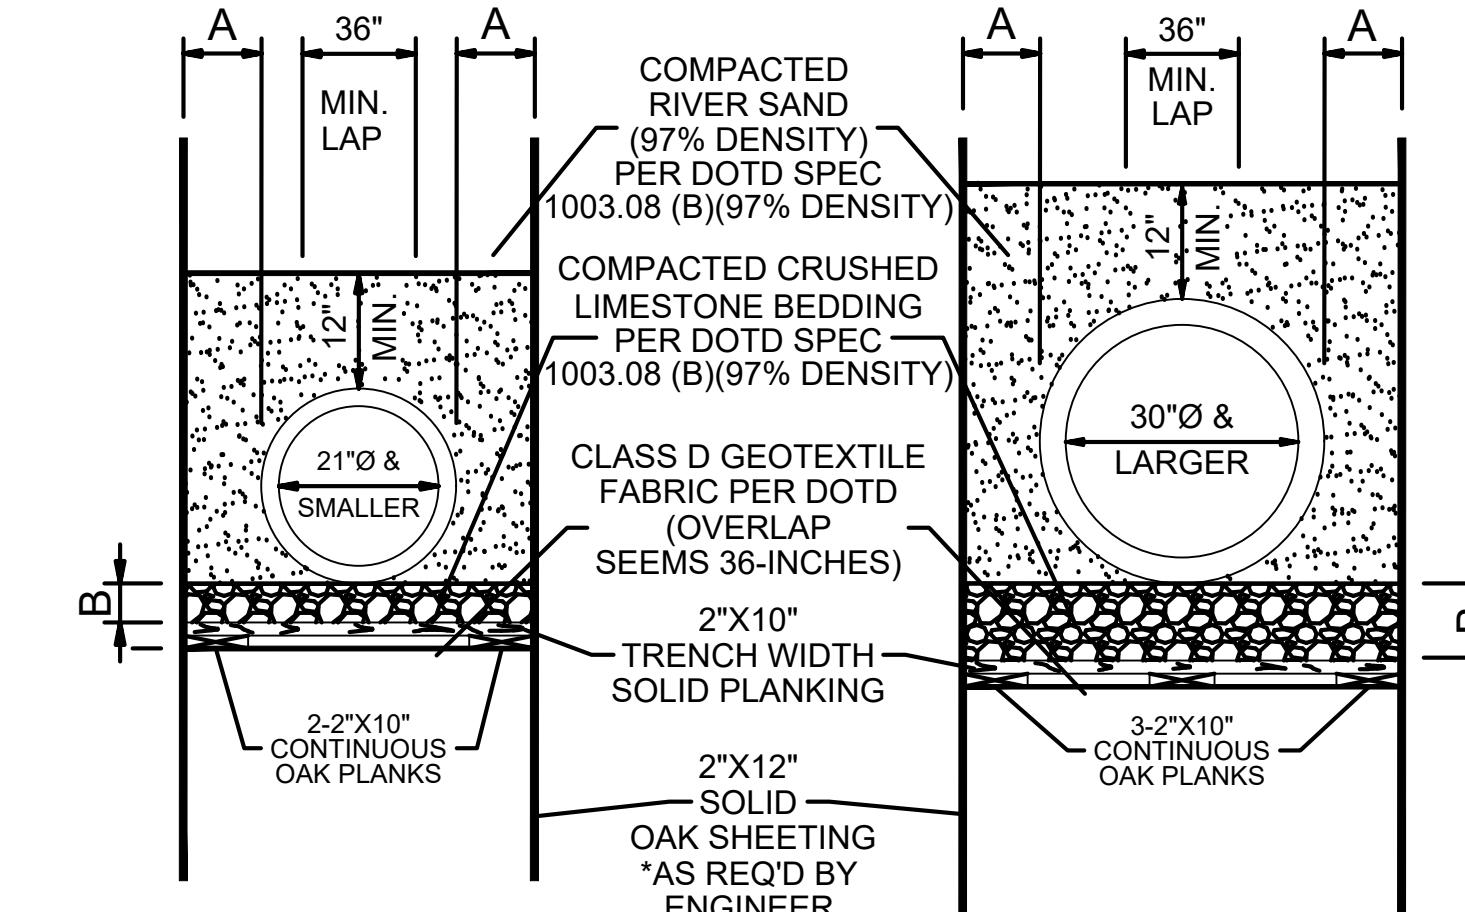

CIRCULAR PIPE DRAIN LINES

N.T.S.

DRAIN LINE BEDDING AND BACKFILL DETAILS FOR RCP & RCPA

DRAIN LINE BEDDING NOTES:

THE DEPARTMENT OF PUBLIC WORKS RESERVES THE RIGHT TO MODIFY PIPE BEDDING REQUIREMENTS IN ACCORDANCE WITH EXISTING FIELD CONDITIONS ENCOUNTERED DURING CONSTRUCTION.

ALL CONCRETE PIPE SHALL BE A.S.T.M. C-76 CLASS III, WALL B, REINFORCED CONCRETE PIPE WITH TYPE 2 JOINT, AND WRAPPED WITH AN 36" PLASTIC FILTER CLOTH (D.O.T.D. SPEC. 1019) CENTERED ON THE JOINT AND LAPPED 36" REJECT PIPE, COMMONLY CALLED "SECONDS", WILL NOT BE ACCEPTABLE. (N.D.P.)


MINIMUM COVER REQUIREMENTS TO BE 12" FOR DRAIN LINES LOCATED WITHIN ROADWAY AND 18" FOR DRAIN LINES LOCATED OUTSIDE OF ROADWAY.

SHETING IS AT THE OPTION OF THE CONTRACTOR. NO TIMBER SHEETING IS TO BE PULLED FROM THE GROUND. TIMBER SHEETING, WHEN USED, SHALL BE CUT OFF TO A MINIMUM OF 3' BELOW GRADE AND LEFT IN PLACE.

JOINT SHALL BE WRAPPED WITH A 36" WIDE GEOTEXTILE FABRIC (D.O.T.D. SPEC. 1019) CENTERED ON THE JOINT AND LAPPED 36" REJECT PIPE, COMMONLY CALLED "SECONDS", WILL NOT BE ACCEPTABLE. (N.D.P.)


PIPE BEDDING LIMESTONE		
57 LIMESTONE		
U.S. SIEVE	METRIC SIEVE	PERCENT PASSING
1 1/2"	37.5 mm	100
1"	25 mm	95-100
1/2"	12.5 mm	25-60
#4	4.75 mm	0-10
#8	2.36 mm	0-5

MODIFIED 610 LIMESTONE		
U.S. SIEVE	METRIC SIEVE	PERCENT PASSING
1 1/2"	37.5 mm	100
1"	25 mm	90-100
3/4"	19 mm	70-100
1/2"	12.5 mm	60-90
3/8"	9.5 mm	50-80
#4	4.75 mm	35-65
#40	425 μ m	12-32
#200	75 μ m	5-12

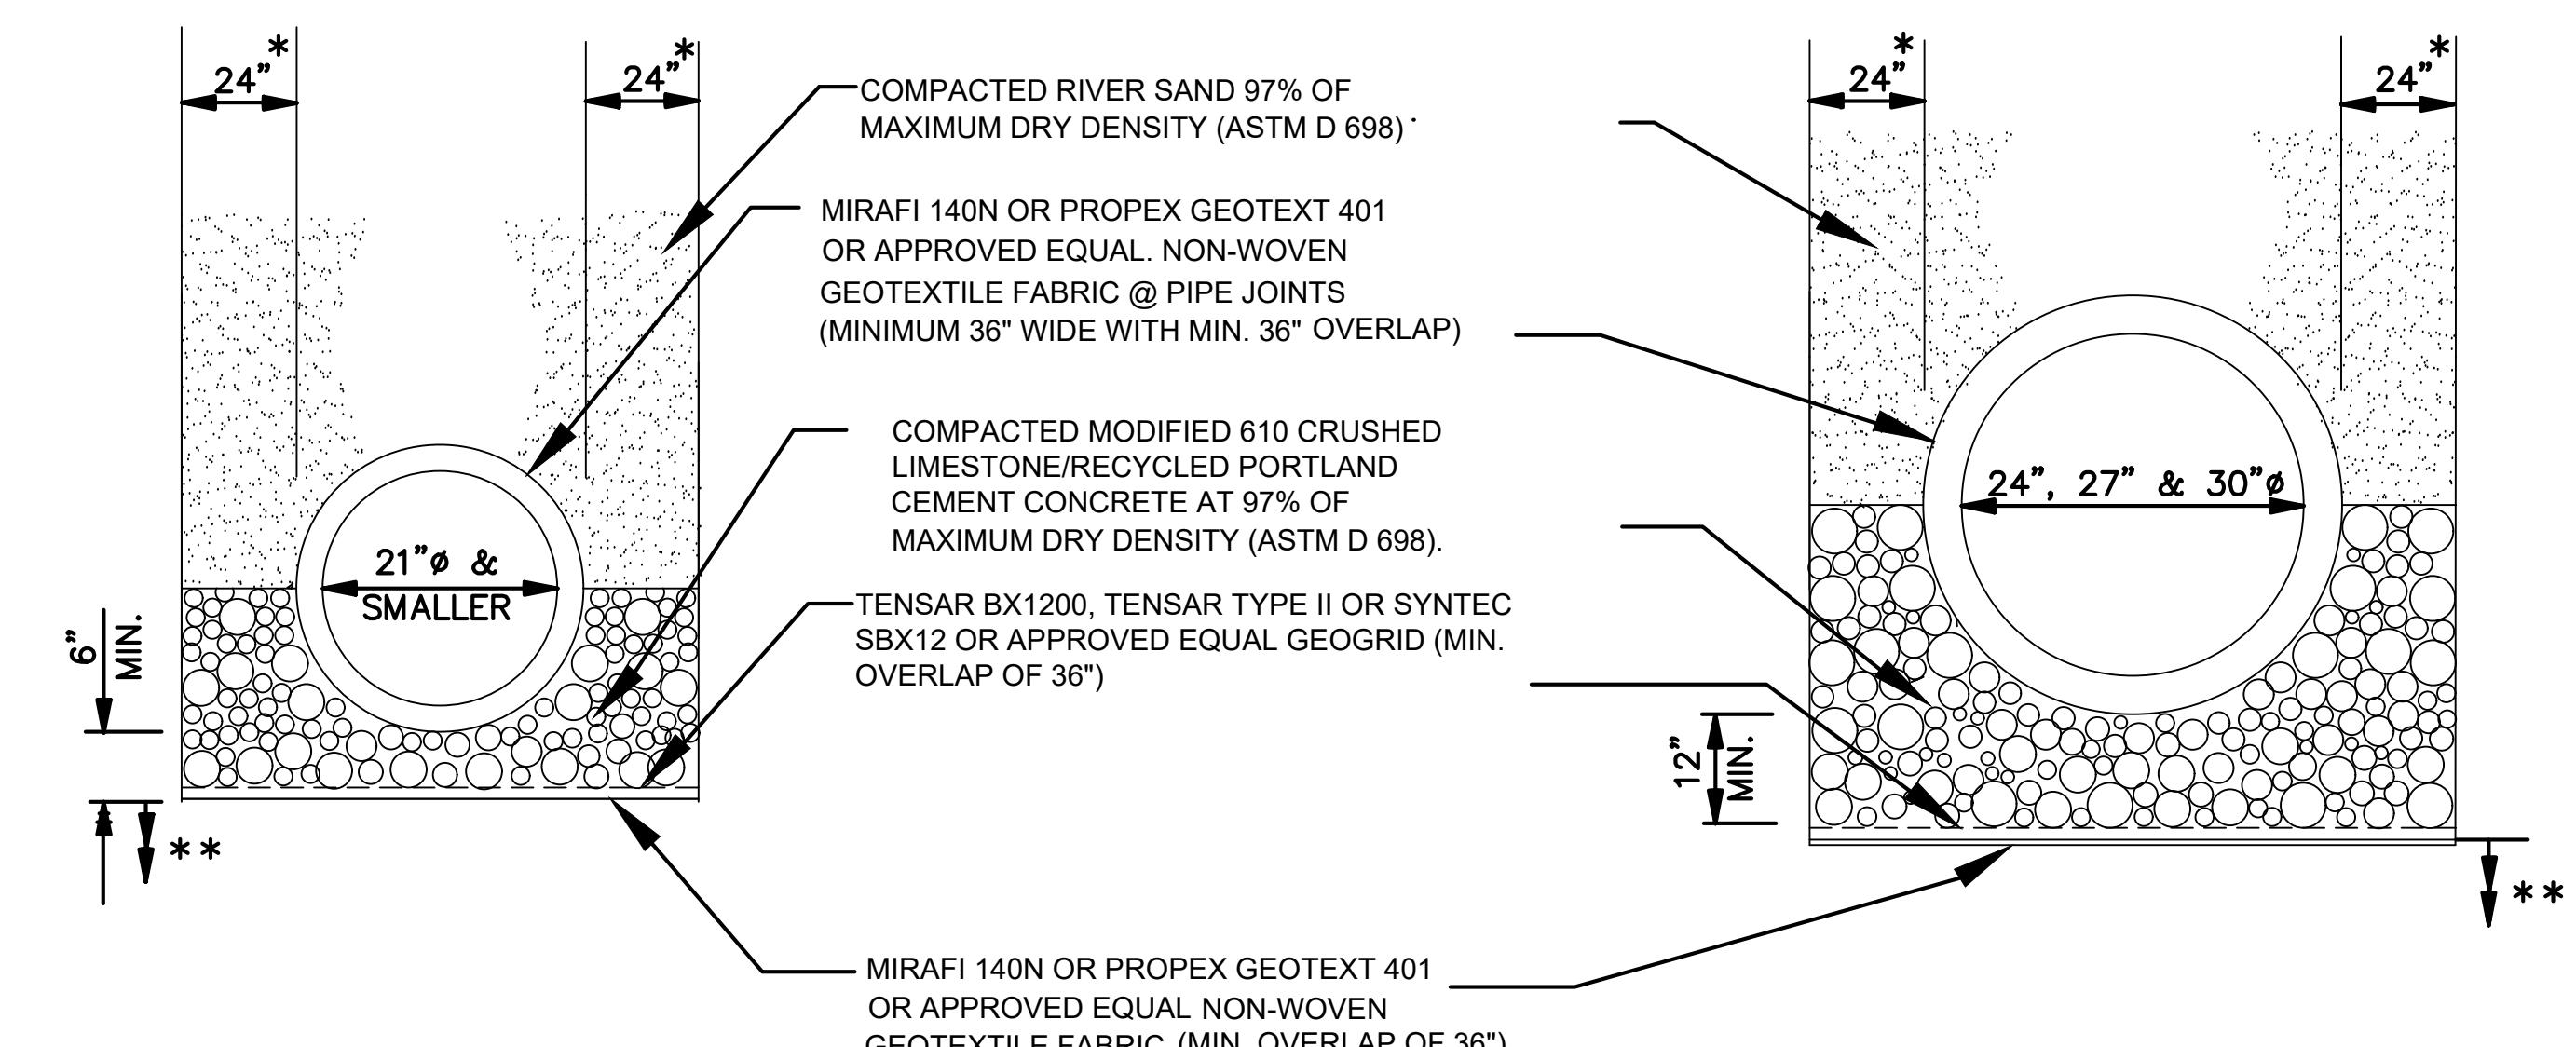

SMALL (RCP) & [RCPA] PIPE TRENCH DETAILS

N.T.S.

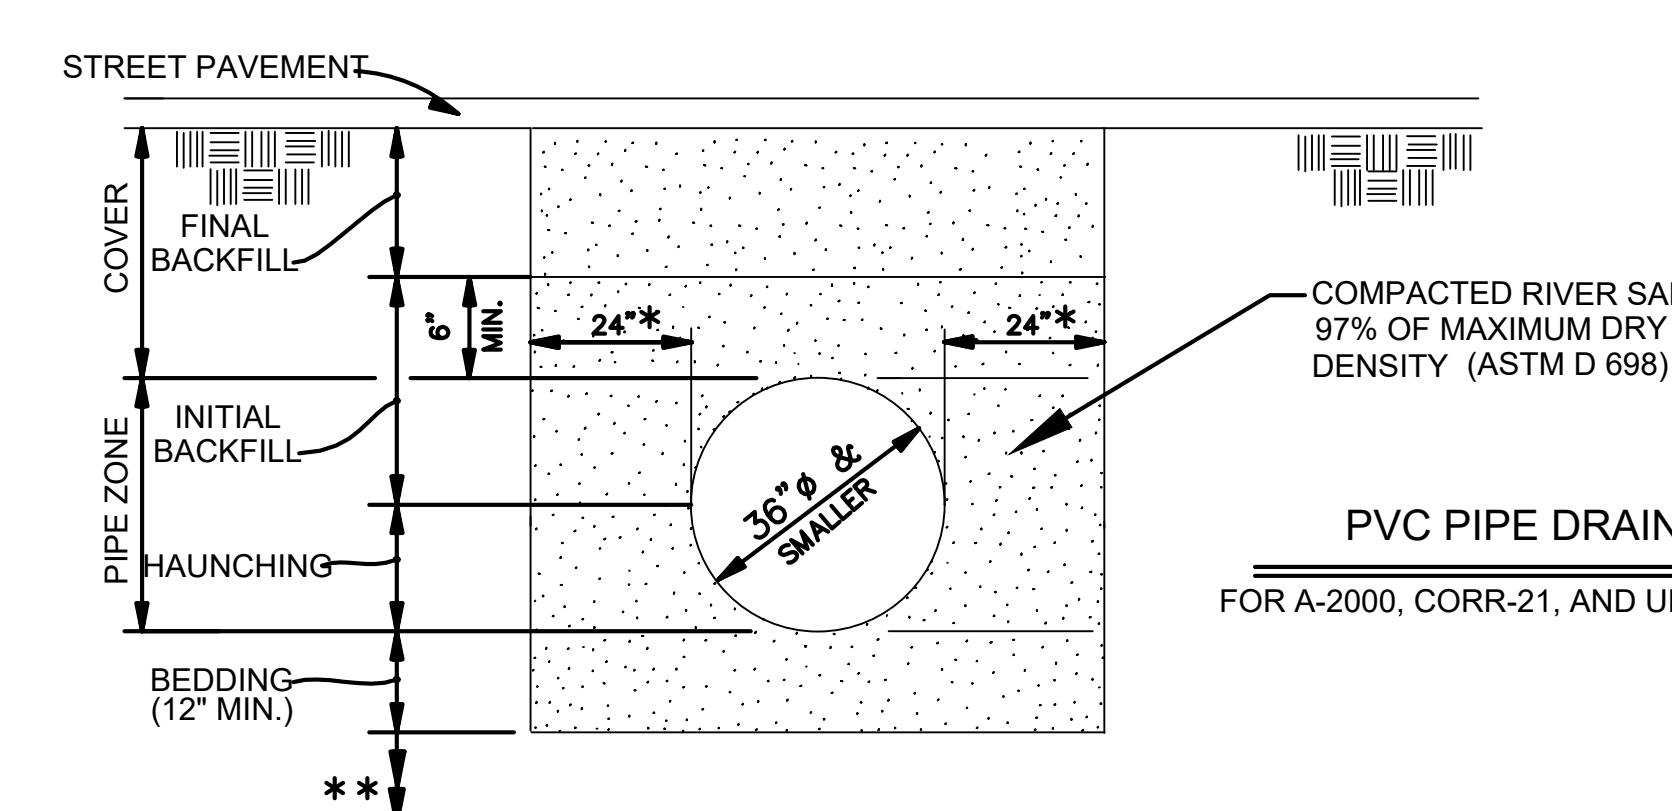

PVC PIPE DRAIN LINE STANDARD TRENCH DETAIL

FOR A-2000, CORR-21, AND ULTRA CORR PVC PIPE (ASTM F-794 AND ASTM D2321) N.T.S.

MIN. COVER (PVC PIPE)	PAVEMENT TYPE
12"	CONCRETE
18"	ASPHALT
24"	NON-PAVED

PROJECT NAME :

PROJECT NUMBER:



DATE	10.28.2019
DRAWN BY	MF/AR
SCALE:	NTS
FILENAME: S:\Public Works Shared\St. Bernard Standard Details	

ST. BERNARD PARISH GOVERNMENT	
STANDARD DETAIL PLANS	
DRAIN LINE BEDDING AND BACKFILL DETAILS	

APPROVED BY  
 DATE  
 THIS DOCUMENT WILL BE CONSIDERED A COPY ONLY, UNLESS EMBOSSED BY A REGISTERED ENGINEERS SEAL

DRAWING NUMBER  
 SD - 8  
 SHEET 8 OF 13